Standard C/T Metering Diagram
Plan 10

Minimum space allowance in the cabinet for meter, testblock, fuses and recorder is 600mm x 600mm.

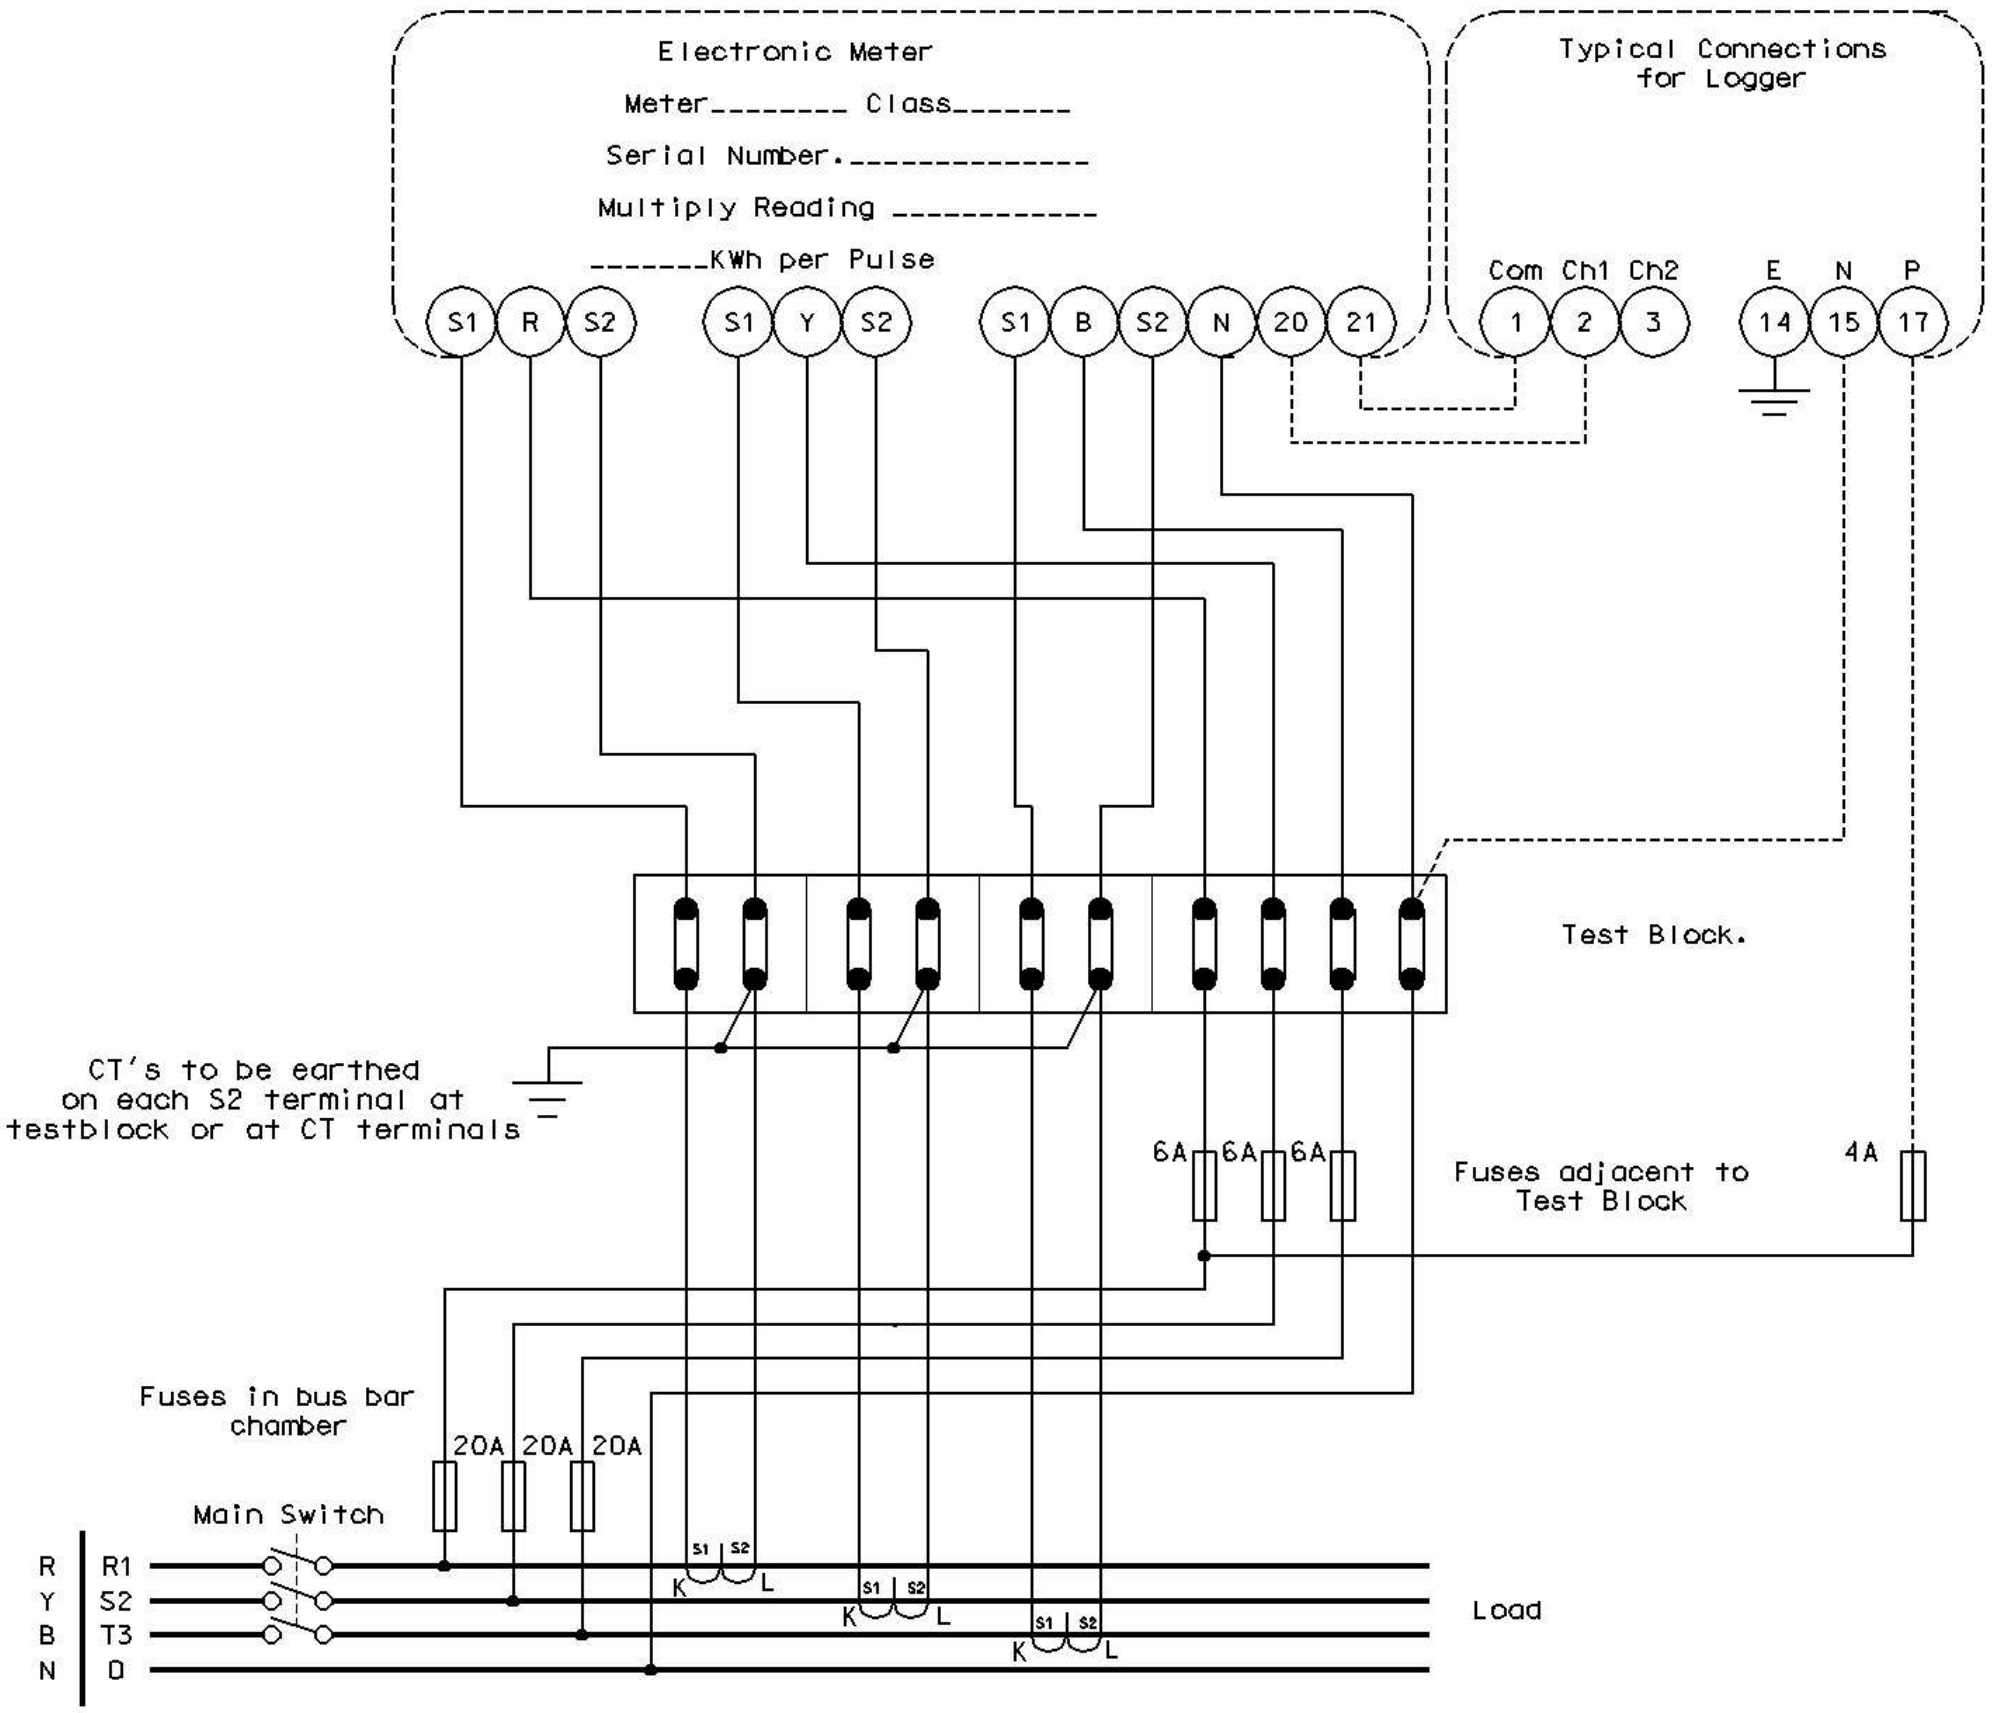

Potential Conductor_____mm² (minimum 2.5mm²)

Conductor from CT to Test Block_____mm² (minimum 2.5mm²)

CT cable run length (CT to meter)_____metres

CT Ratio = _____

CT No Red _____

Yellow _____

Blue _____

Make:_____

Class:_____

Design Certificate No = _____

Data required for each installation

Equipment in meter cabinet :

1 x Meter

1 x Recorder (future)

1 x Test Block

4 x Fuses

Northpower M.R. Garland BE MIPENZ Chief Executive

Head Office
28 Mt Pleasant Road
Private Bag 9018

Telephone 0-9-430 1803
Facsimile 0-9-430 1804
http://www.northpower.co.nz

Rev	Amendments	By	Checked	Date
C	Change Cable Size	CP	MH	8/11/01
D	Clarify wording for CTs	CP	MH	5/12/01
E	Change Plan Description	CP	RW	05/07/05

Title: **Standard connections for 230V/400V, 3 Phase, 4 wire, CT meter and Test Block**

Scale NTS Sheet size A3

Drawn	J. Antunovich	Date	18/3/97
Checked	M. Hayes	Date	8/11/01
Approved	S. Love	Date	5/12/01
Issue	E	Date	28/01/03

Par Number 2G228s3